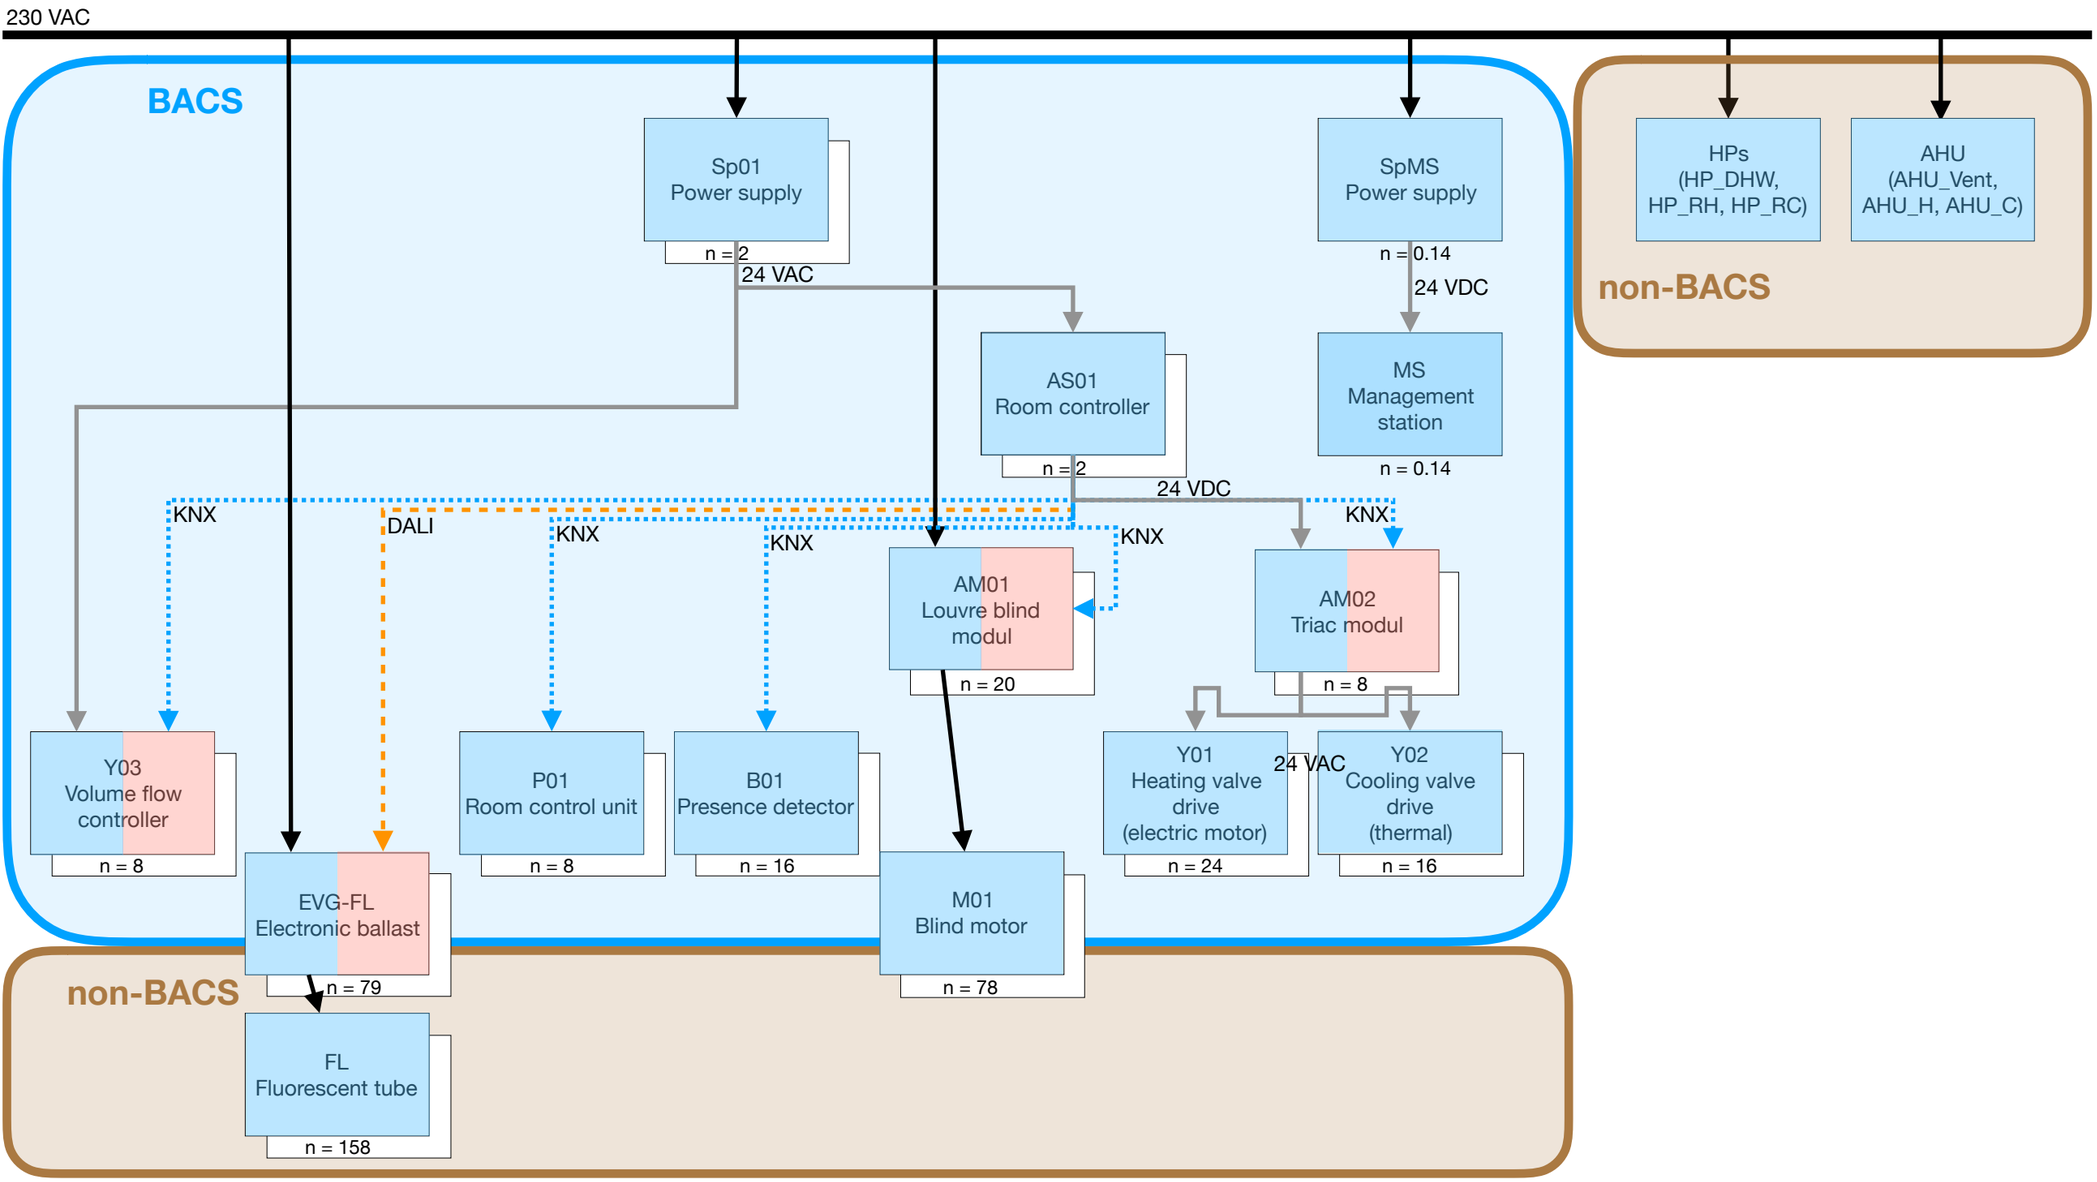
230 VAC
BACS
Sp01
Power supply
n = 2
24 VAC
SpMS
Power supply
n = 0.14
24 VDC
HPs
(HP_DHW,
HP_RH, HP_RC)
AHU
(AHU_Vent,
AHU_H, AHU_C)
non-BACS
AS01
Room controller
n = 2
24 VDC
MS
Management
station
n = 0.14
KNX
DALI
KNX
KNX
KNX
KNX
AM01
Louvre blind
modul
n = 20
AM02
Triac modul
n = 8
Y03
Volume flow
controller
n = 8
P01
Room control unit
n = 8
B01
Presence detector
n = 16
Y01
Heating valve
drive
(electric motor)
n = 24
24 VAC
Y02
Cooling valve
drive
(thermal)
n = 16
EVG-FL
Electronic ballast
n = 79
M01
Blind motor
n = 78
non-BACS
FL
Fluorescent tube
n = 158